


Campus Re-Staffing Water Testing Results

Drinking Fountains and Food Prep Sinks Tested From May 6 to August 19, 2021

Samples = 227

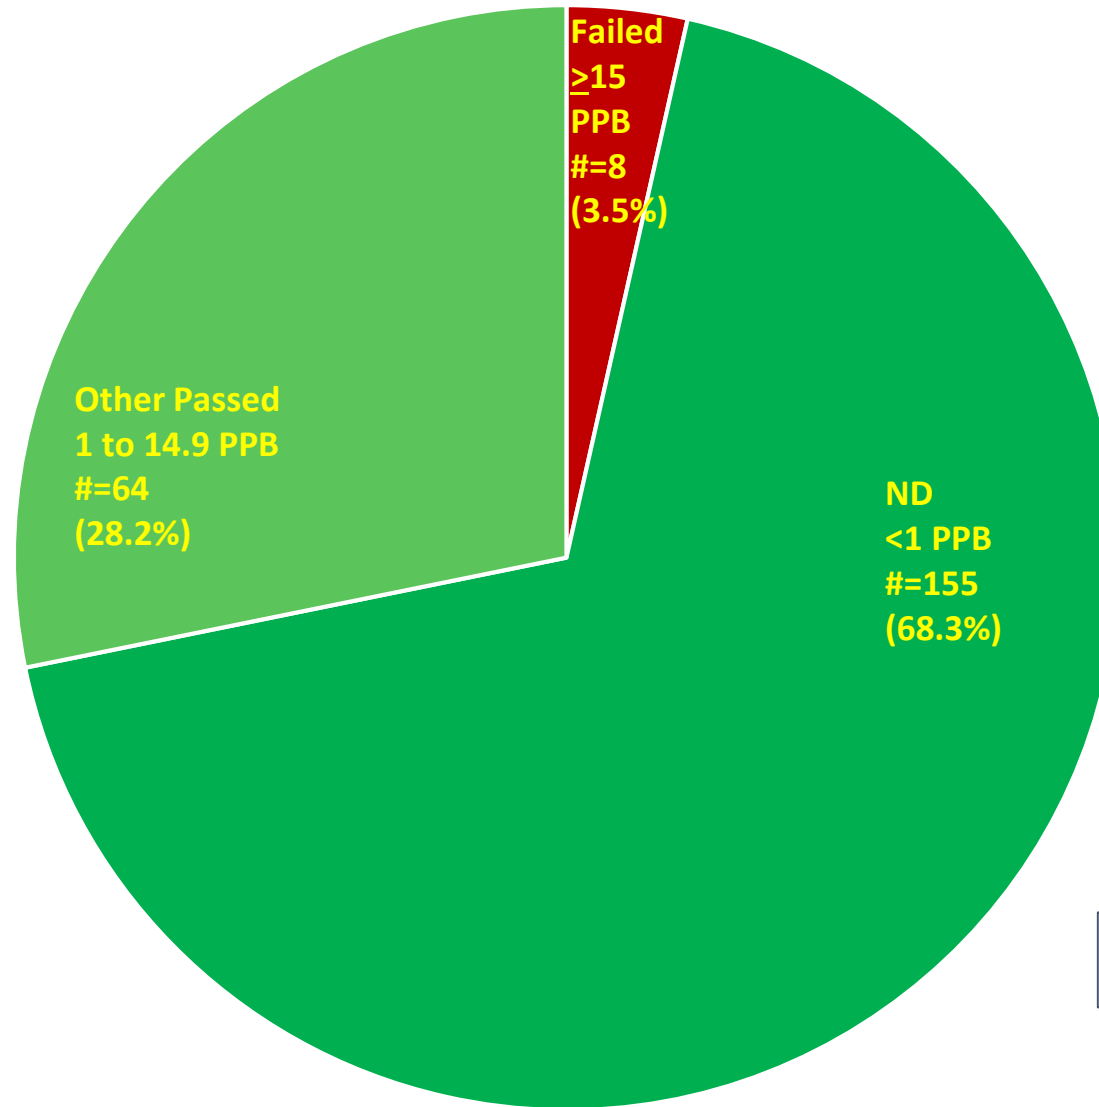

96.5% Pass Rate

Failed

ND

Other Passed